KEY NOTES:

1. ELEVATION RELIEF HUB DRAIN SHALL BE AT SAME HEIGHT AS TOP OF GREASE INTERCEPTOR.
2. FLOW CONTROL VALVE/VENT NOT REQUIRED IF GREASE INTERCEPTOR IS EQUIPPED WITH INTEGRAL FLOW CONTROL DEVICE.
3. SIZE PER OPSC. MINIMUM CAPACITY 20 GPM.
4. MINIMUM 1" AIR GAP REQUIRED PER OPSC.

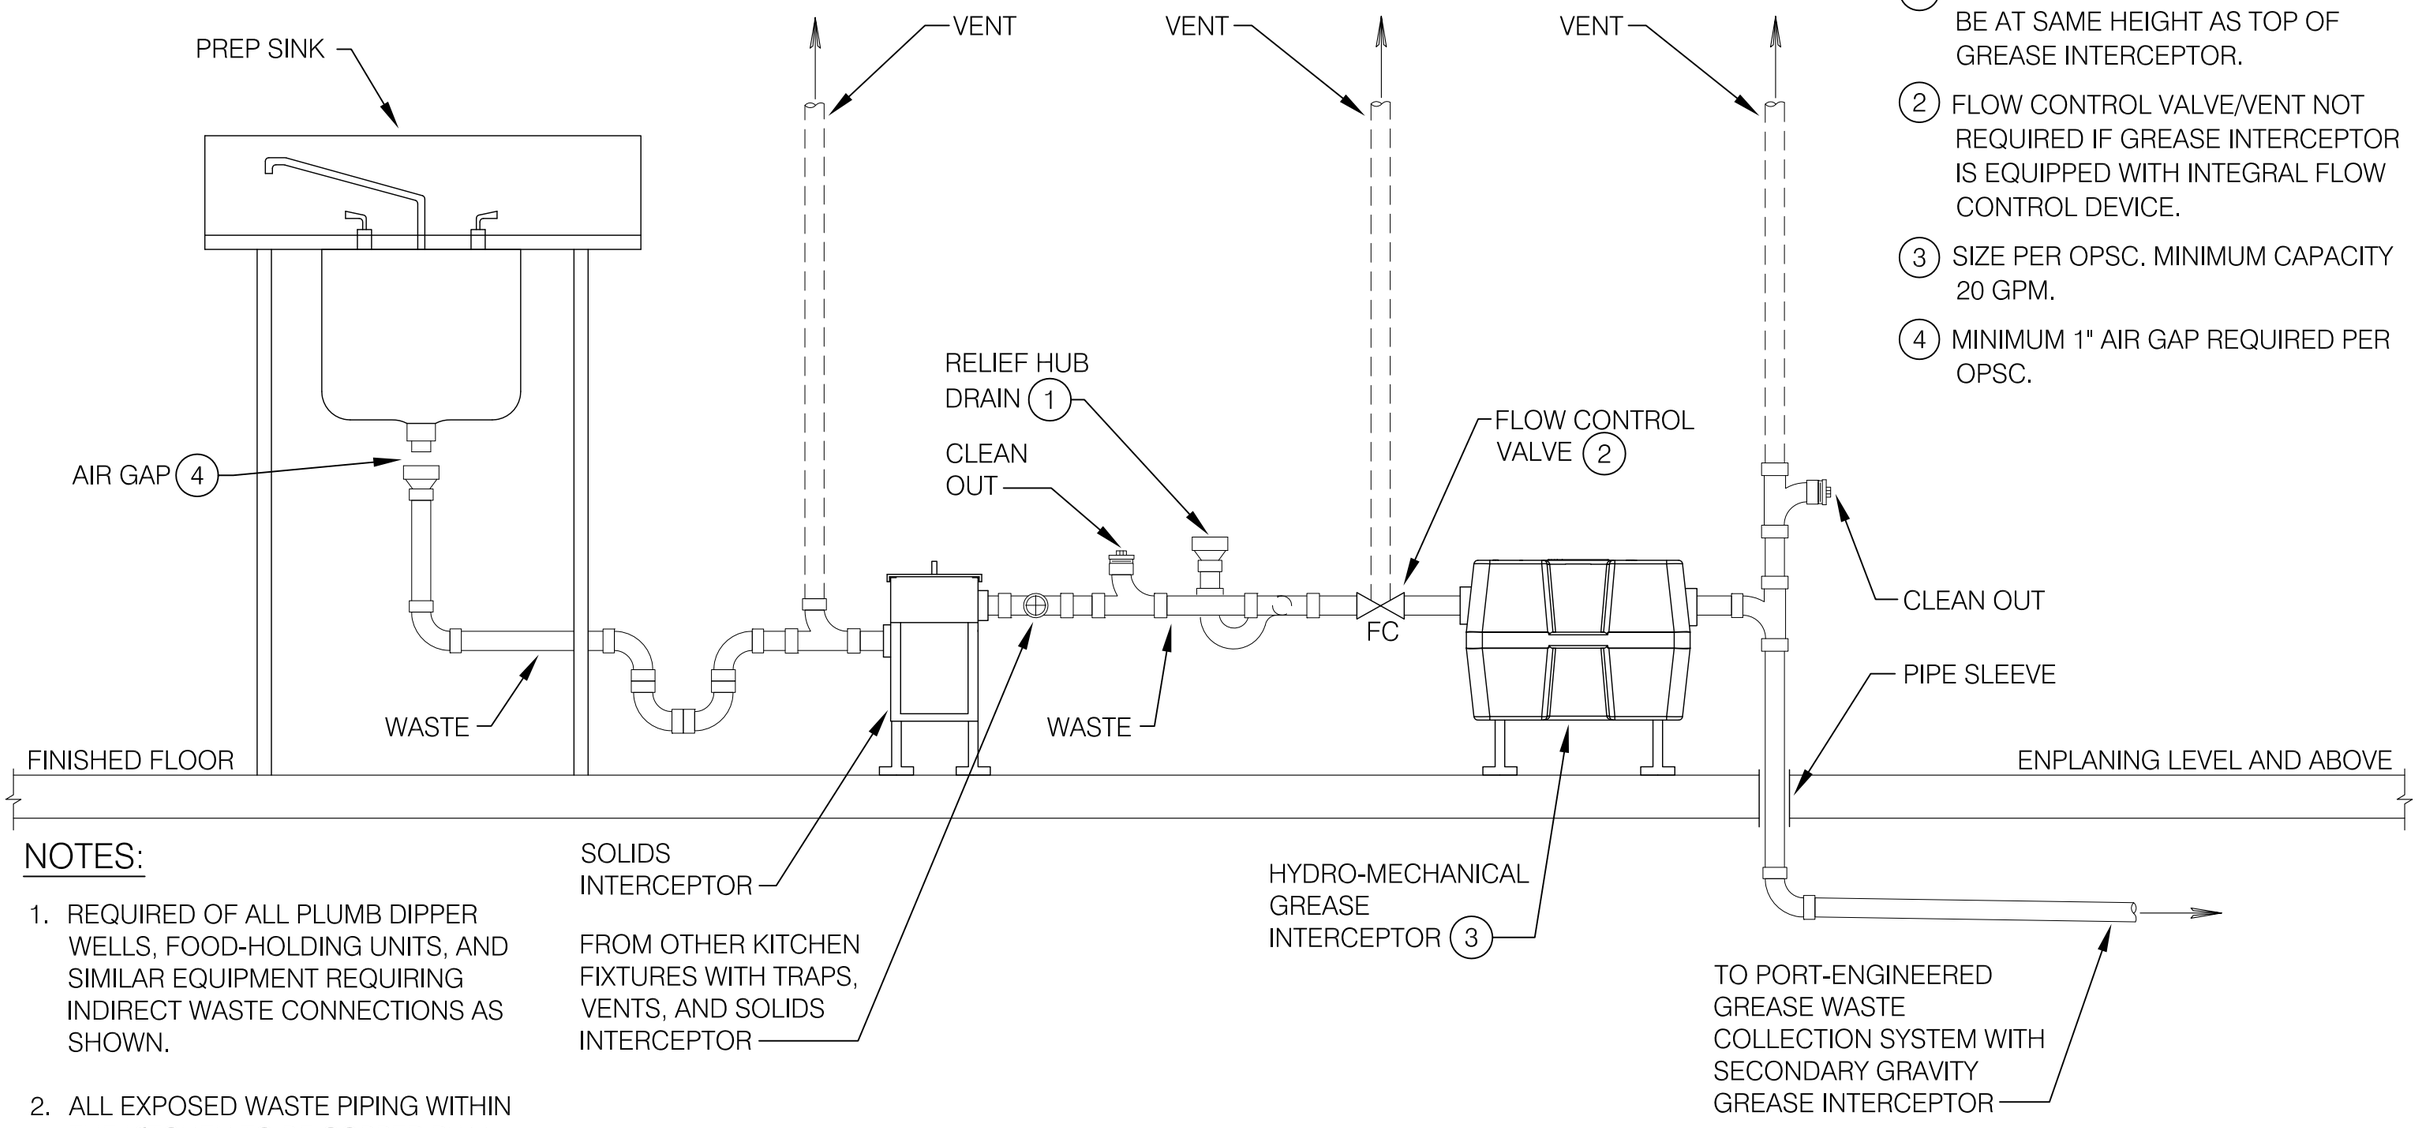

NOTES:

1. REQUIRED OF ALL PLUMB DIPPER WELLS, FOOD-HOLDING UNITS, AND SIMILAR EQUIPMENT REQUIRING INDIRECT WASTE CONNECTIONS AS SHOWN.
2. ALL EXPOSED WASTE PIPING WITHIN THE KITCHEN TO BE COPPER DWV.

2211 SINK - FOOD PREP OR INDIRECTLY DRAINED EQUIPMENT

SCALE: NTS