KEY NOTES:

1. ELEVATION RELIEF HUB DRAIN SHALL BE AT SAME HEIGHT AS TOP OF GREASE INTERCEPTOR.
2. FLOW CONTROL VALVE/ VENT NOT REQUIRED IF GREASE INTERCEPTOR IS EQUIPPED WITH INTEGRAL FLOW CONTROL DEVICE.
3. SIZE PER OPSC. MINIMUM CAPACITY 20 GPM.

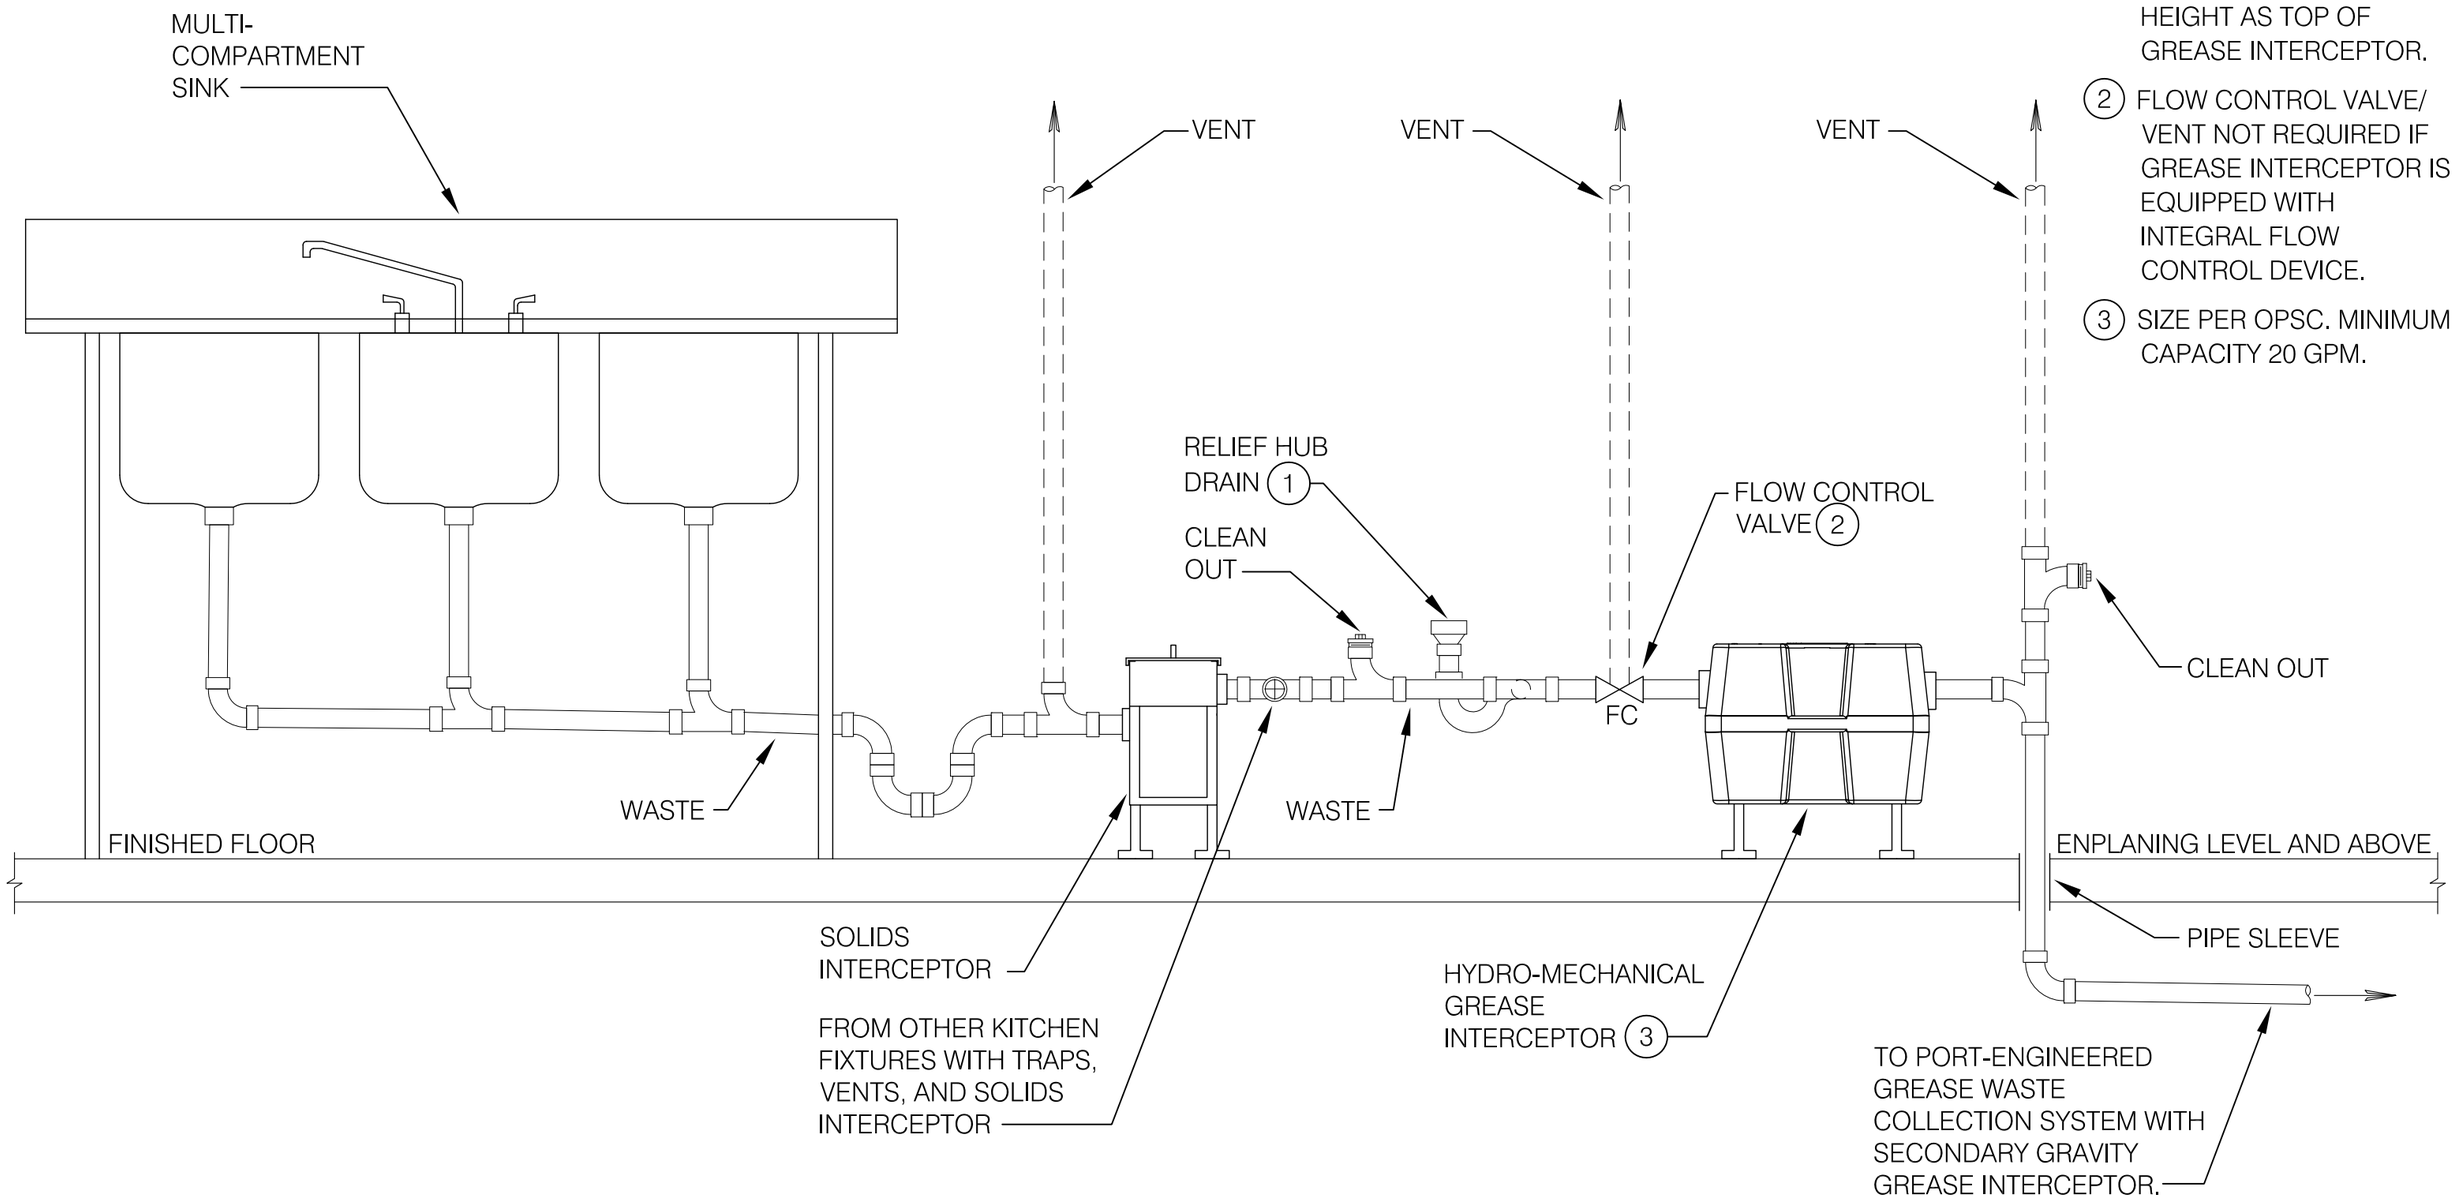

2213 SINK - MULTI COMPARTMENT

SCALE: NTS