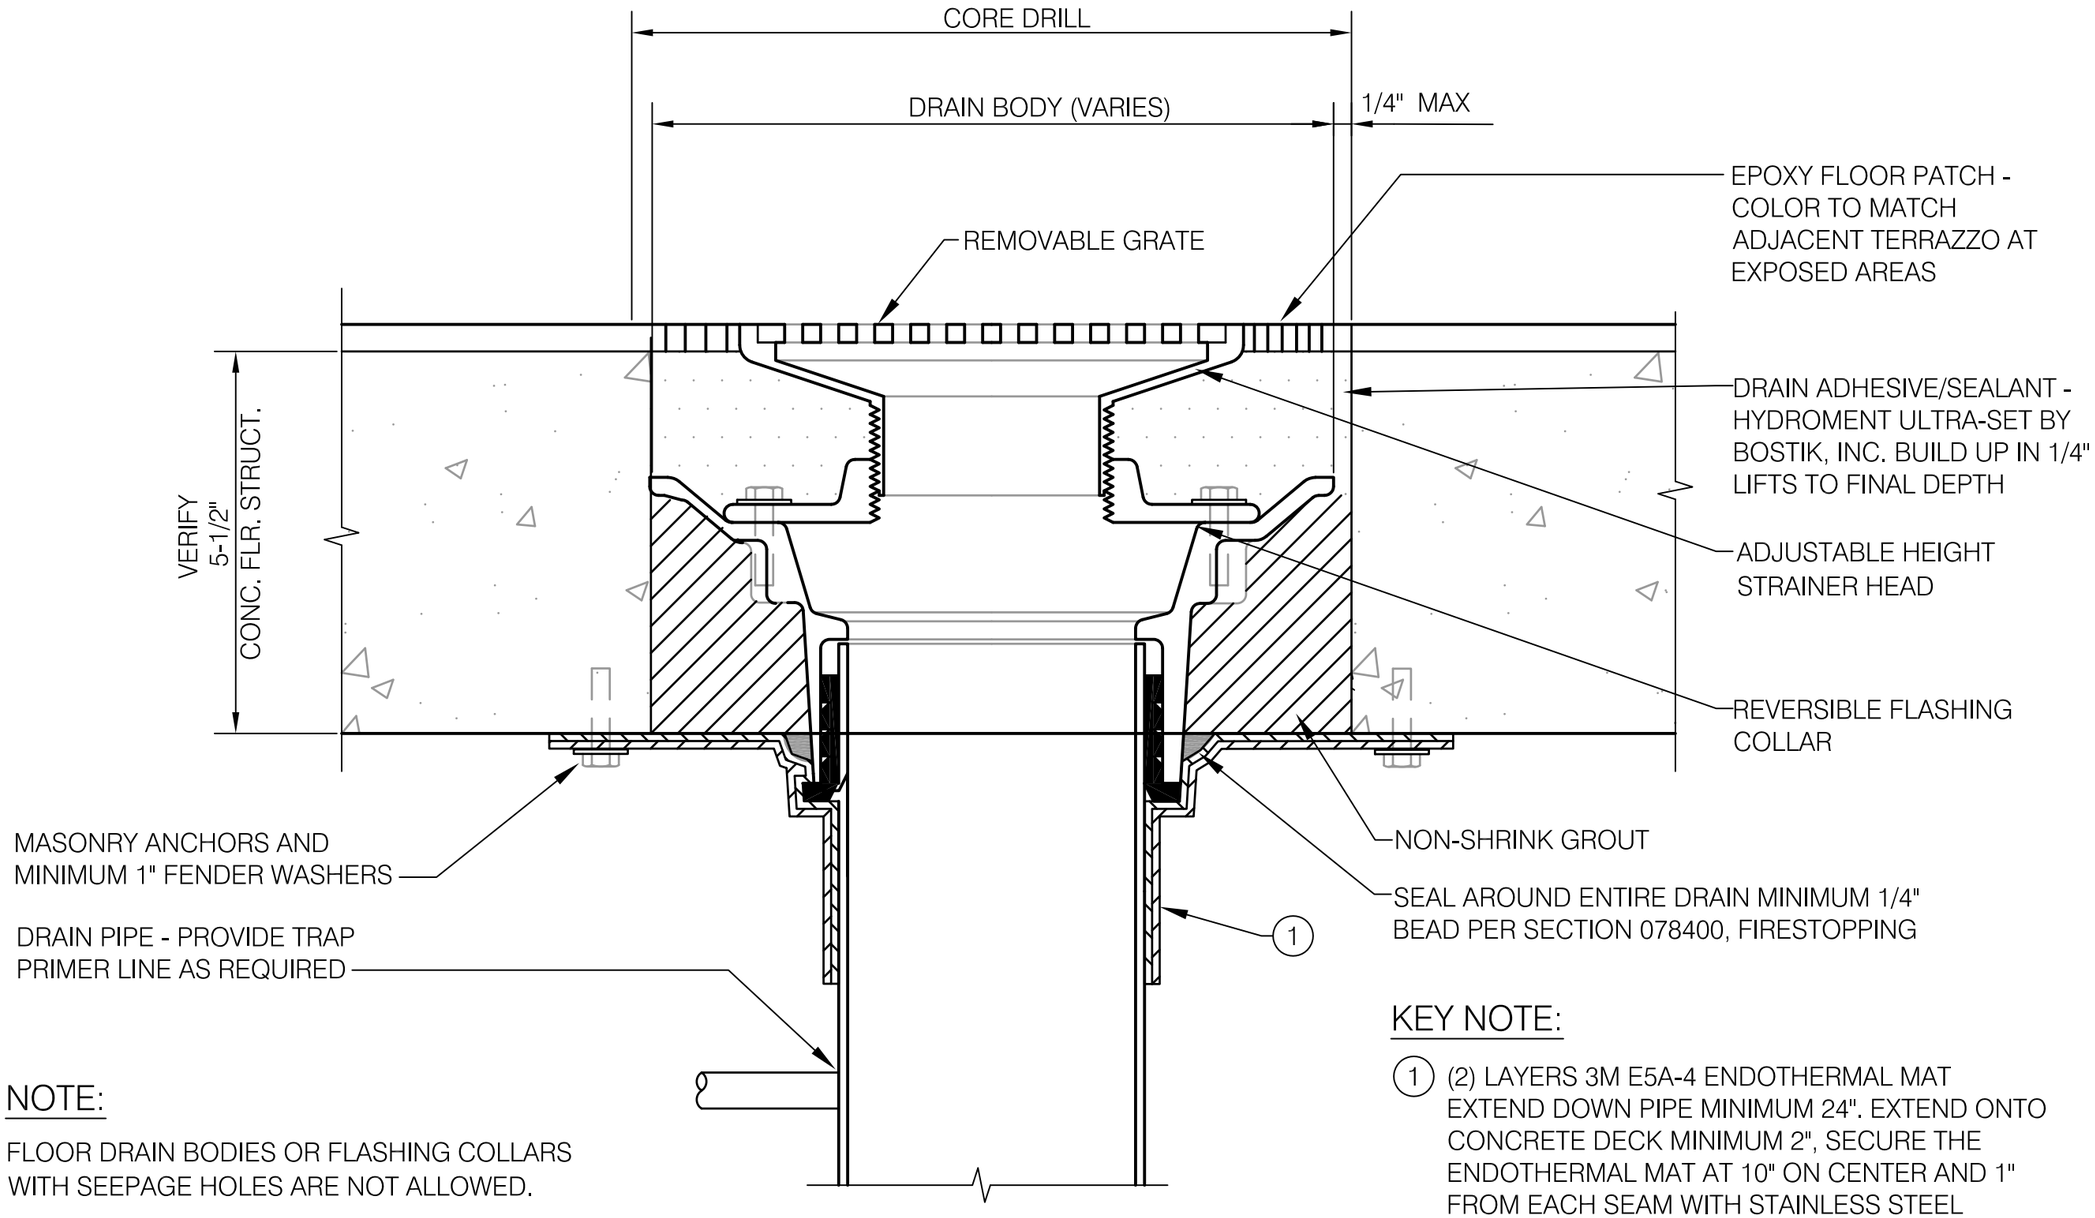

NOTE:

FLOOR DRAIN BODIES OR FLASHING COLLARS WITH SEEPAGE HOLES ARE NOT ALLOWED.

KEY NOTE:

1 (2) LAYERS 3M E5A-4 ENDOTHERMAL MAT EXTEND DOWN PIPE MINIMUM 24". EXTEND ONTO CONCRETE DECK MINIMUM 2", SECURE THE ENDOTHERMAL MAT AT 10" ON CENTER AND 1" FROM EACH SEAM WITH STAINLESS STEEL BANDING. ALL SEAMS, BOTH LONGITUDINALLY AND CIRCUMFERENTIALLY, ARE TO BE TAPED WITH 3M T-49 TAPE.

2223 FLOOR DRAIN - CONCRETE FLOOR - METALLIC PIPE

SCALE: NTS