


DEPLANING LEVEL

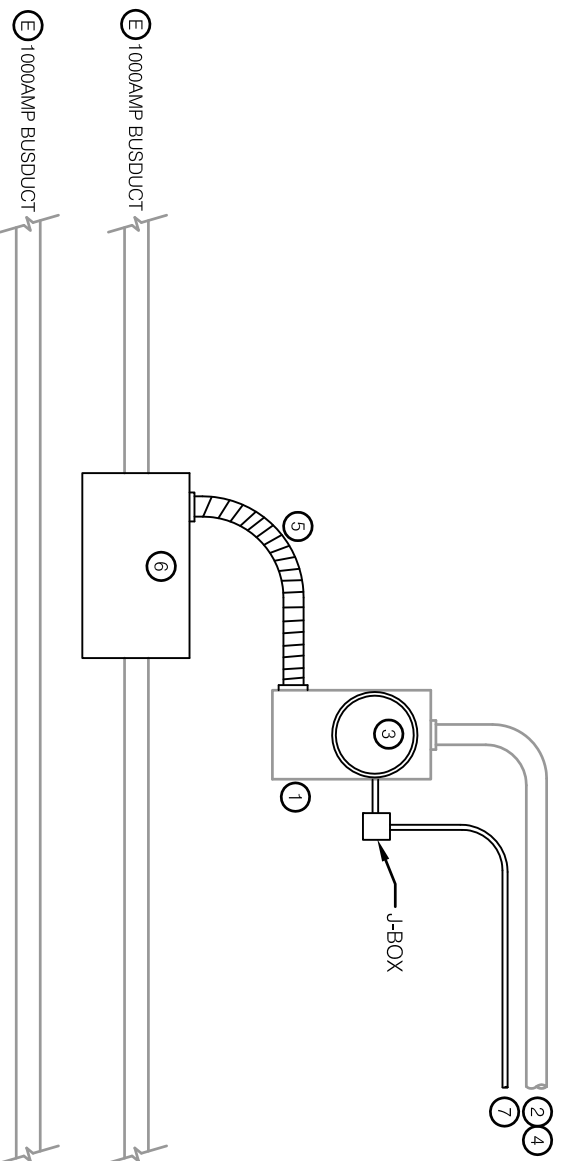

TUNNEL LEVEL

NOTES:

1. TENANT SHALL COORDINATE WITH THE PORT FOR THE CONNECTION TO THE BUSDUCT AND WHICH BUSDUCT TO USE.
2. ITEMS SHOWN AS SCREENED BACK LINES ARE EXISTING.

KEY NOTES:

1. EXISTING, METERING SOCKET ENCLOSURE, WALL MOUNTED ABOVE THE EXISTING BUSDUCTS.
2. EXISTING, 2" CONDUIT TO RESPECTIVE RETAIL SPACES.
3. BY TENANT: PROVIDE METER PER TENANT STANDARDS.
4. BY TENANT: PROVIDE CONDUCTOR FROM THE METER ENCLOSURE TO THE LEASE SPACE.
5. BY TENANT: PROVIDE SEALTIGHT FLEX CONDUIT AND CONDUCTORS BETWEEN THE METER ENCLOSURE AND BUSPLUG UNIT.
6. BY TENANT: PROVIDE BUSDUCT PLUG-IN OVERCURRENT EQUIPMENT.
7. BY TENANT: PROVIDE DATA CONDUIT AND 2/C #18 SH CABLE TO TERMINAL REVENUE METERING SYSTEM.

2601 METERING - BUSDUCT
SCALE: NTS