


NOTES:

- USE LAMINATED LABELS AT ALL INTERIOR AND PROTECTED LOCATIONS. USE PROFESSIONALLY ENGRAVED, WHITE ENAMEL FILLED BRASS LABELS IN ALL AREAS EXPOSED TO WEATHER AND/OR SUNLIGHT, AND IN ENVIRONMENTAL AIR HANDLING SPACES.
- COLOR CODE FOR LABELS SHALL BE AS FOLLOWS:

PORT	BLUE
FAA	YELLOW
AIRLINES	GREEN
TELCO	RED
OTHER TENANTS	BLACK
EMERGENCY	WHITE WITH RED LETTERS

(X) CONDUIT AND INTERDUCT IDENTIFICATION
SCALE: NTS

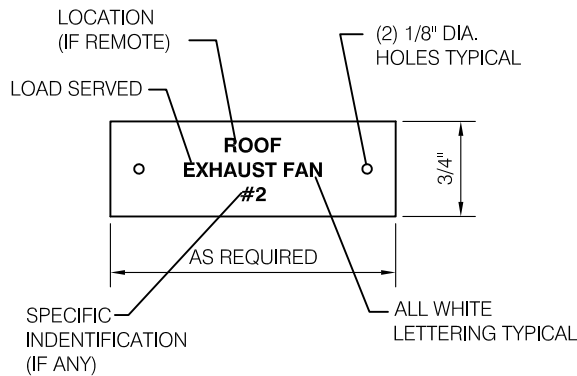

(X) EQUIPMENT IDENTIFICATION
SCALE: NTS

DB#000001

(X) CABLE LABEL
SCALE: NTS

(2661) ELECTRICAL IDENTIFICATION
SCALE: NTS

- INSTALL CONDUIT AND INNERDUCT LABELS AT A MAXIMUM SPACING OF 50 FEET AND AT ENTRANCES OF ALL JUNCTION BOXES, DUCT BANKS, DISTRIBUTION PANELS, MOTOR CONTROL CENTERS, PANELBOARDS, ETC. PROVIDE A MINIMUM OF ONE LABEL PER ROOM OR SPACE.
- INSTALL EQUIPMENT LABELS WITH STAINLESS STEEL #4 SCREWS.
- SYSTEM EXAMPLES: POWER, FIRE ALARM, HVAC, COMMUNICATIONS, SIGNAL, TELEPHONE, REVENUE CONTROL.
- LABEL CABLES WITH PREPRINTED LABEL. LABELS SHALL BE COMPUTER GENERATED WRAPAROUND WITH A REFERENCE NUMBER PREFACED WITH THE LETTERS DB. AT A MINIMUM, LABEL END, AND 3 EVENLY SPACED INTERMEDIATE POINTS
- COMPLETE INSTALLATION OF LABELS PRIOR TO CEILING INSTALLATION.